

DOUBLE METAL STUDS @ ARCOPLAST
 PANEL JOINTS @ 4'-0" (1.2 m) O.C. (TYP.)
 (CONSULT ARCOPLAST & STRUCTURAL
 FRAMING REQUIREMENTS PER
 ARCHITECT/ENGINEER)

PANCAKE HEAD FRAMING SCREW,
 #8 x .625" (15.88 mm) @ 12" (30 cm) O.C. (TYP.)

RIGID INSULATION BOARD
 THICKNESS CAN VARY

METAL STUDS @ 16" (400 mm) O.C.

16" (400 mm) O.C. (TYP. STUD SPACING)

5/8" (15.9 mm) FIRE RATED GYPSUM BOARD

ARCOPLAST STRUCTURAL ADHESIVE (A-2020)

ARCOPLAST EXTRUDED ALUMINUM SPLINE

ARCOPLAST BIO-SEAL (A-1010)
 WHITE FINISHING COMPOUND

ARCOPLAST 3/8" (9.5 mm) GFRMC
 WALL PANEL

1/2" WIDE 3M TWO SIDED TAPE (VHB-4959) W/
 CONTINUOUS BEAD OF ARCOPLAST STRUCTURAL
 ADHESIVE (A-2020), SIDE BY SIDE, ADHESIVE SHALL
 BE LOCATED CLOSEST TO ARCOPLAST SPLINE

1-1/2" (38.1 mm) x 1/2" (12.7 mm) METAL FURRING CHANNEL
 RECESSED INTO THE RIGID INSULATION BOARD
 LOCATED AT 16" (400 MM) O.C.

THE INFORMATION CONTAINED IN THIS DOCUMENT IS PROPRIETARY TO ARCOPLAST. ALL COPYRIGHTS AND OTHER PROPRIETARY RIGHTS APPLICABLE SHALL REMAIN AT ALL TIMES ARCOPLAST'S PROPERTY. DOCUMENTS SHALL NOT BE USED, COPIED OR HARVESTED FROM THE CAD FILE, THE INFORMATION CONTAINED WITHIN WITHOUT THE WRITTEN CONSENT OF ARCOPLAST. DOCUMENTS, DESIGNS, DRAWINGS AND SPECIFICATIONS ARE CONCEPTUAL IN NATURE AND ARE INTENDED TO SET FORTH DESIGN INTENT ONLY AND ARE NOT TO BE USED FOR ENGINEERING PURPOSES.


GFRMC WALL PANEL SPLINE ASSEMBLY, INSULATED WALL

DWG #
 PP-30-MC

SCALE
 6" (1:2)

DATE
 2/20/2020

CHECKED
 GB

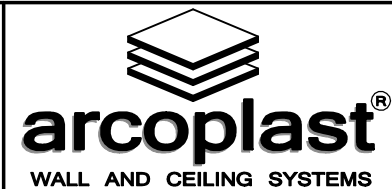

1873 WILLIAMSTOWN DRIVE
 ST. PETERS, MISSOURI USA 63376
 T: 888-736-2726 F: 636-978-7782

WWW.ARCOPLAST.COM