

2810 Clark Avenue • St. Louis, MO 63103-2574 • (314) 531-8080 • FAX (314) 531-8085
 Chemical, Metallurgical, Mechanical, Nondestructive, Environmental Testing, Analyses and Field Service.

ARCOPLAST
 1873 Williamstown Drive
 St. Peters, MO 63376

May 21, 2020
 Lab No. 20P-2156
 Invoice No. 270963
 Page 6 of 26


Attention: Ghislain Beauregard

REPORT OF MECHANICAL TEST

Group 6: **Arcoplast GFRMC Panel 5mm**
 Shear Strength Test- Galv. Metal Plate 1"x3" with A-2020 and 0.5" VHB Tape by 1"
 IPA 50/50 Water Cleaner - A-2020 for 1" Long x 0.5" Wide with VHB 4956 0.5" x 1"
 Sample 1" wide x 5.75" long

SUBJECT: Shear Strength Test
METHOD: Per Client's Instructions
INSTRUMENT: Instron 5500R with Bluehill software
RESULTS:

Specimen #	Max Load (lbf)	Extension @ Max Load (in)	Failure Mode
1	331.7	0.045	Adhesive at Panel
2	229.4	0.073	
3	335.7	0.071	
4	350.0	0.085	Adhesive at Metal
5	173.4	0.054	
Average	284.1	0.066	---

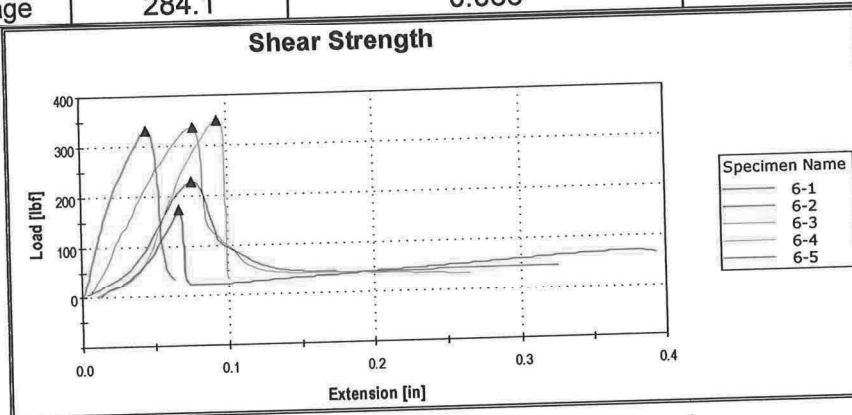


Karl Schmitz, Director
Materials Testing

KS/jlb

